



Cable Label: Cat 6A F/UTP 1			Overall Result:
Date & Time:	16.09.2020 09:26:17	Building:	Unspecified-Building
Limit Type:	TIA - Cat 6A Channel	Floor:	Unspecified-Floor
Cable Name:	CAT 6A FTP	Room:	Unspecified-Room
Connector Name:	Shielded CAT6A	Rack:	Unspecified-Rack
Site:	Birikim	Panel:	Unspecified-Panel
Operator Name:	Ahmet YILDIRIM		

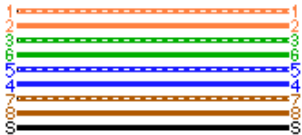



Local Ser. No.:	jw20201903	Remote Ser. No.:	jw20201904
Local Adapter:	Cat 6A Channel	Remote Adapter:	Cat 6A Channel
Local Calibration Date:	Aug 4 2017	Remote Calibration Date:	Aug 4 2017
Device Software:	7.3	Reporting Software:	Build_#909_7.3_2017-07-21_13-37-22

Wiremap: Pass		
		
Length (m):	0.9	ValueLimit Margin: 100.0 99.1
Cable NVP:	68.0	- -
Propagation Delay (ns):	5.0	555.0 550.0
Delay Skew (ns):	1.0	50.0 49.0
Resistance (Ohms):	0.5	25.0 24.5



Insertion Loss: Pass		
	<u>Worst Margin:</u>	<u>Worst Value:</u>
Pair:	Local: 12	Local: 12
Value (dB):	0.3	1.4
Limit (dB):	3.0	47.0
Margin (dB):	2.7	45.6
Frequency (MHz):	1.00	458.00

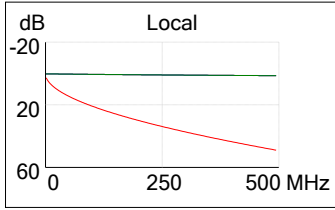



Return Loss: Info				
	<u>Worst Margin:</u>		<u>Worst Value:</u>	
Pair:	Local:	Remote:	Local:	Remote:
Value (dB):	19.4	19.6	14.8	19.1
Limit (dB):	16.1	16.1	6.0	15.4
Margin (dB):	3.3	3.5	8.8	3.7
Frequency (MHz):	38.75	38.25	497.00	45.50

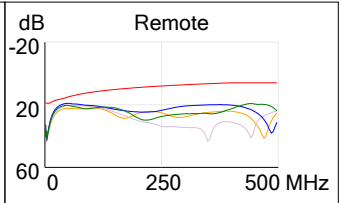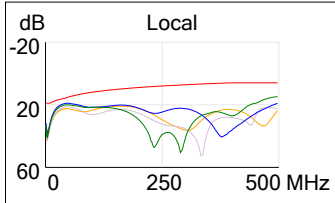

NEXT: Pass	
	<u>Worst Margin:</u>
Pair:	Local: 12-36
Value (dB):	60.7
Limit (dB):	51.7
Margin (dB):	9.0
Frequency (MHz):	19.90

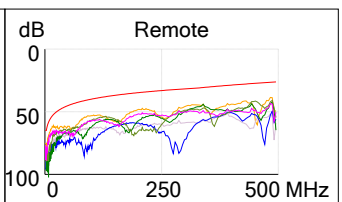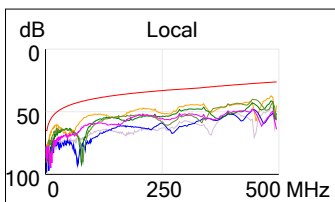

ACR-F: Pass	
	<u>Worst Margin:</u>
Pair:	Local: 36-45
Value (dB):	24.8
Limit (dB):	9.3
Margin (dB):	15.5
Frequency (MHz):	500.00

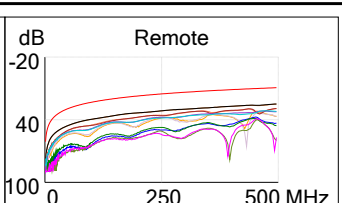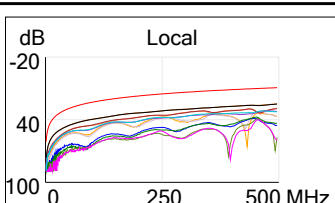

PS-NEXT: Pass		PS-ACRF: Pass	
	<u>Worst Margin:</u>	<u>Worst Value:</u>	<u>Worst Margin:</u>
Pair:	Local: 36	Local: 36	Local: 36
Value (dB):	59.6	34.7	26.8
Limit (dB):	49.4	23.6	9.9
Margin (dB):	10.2	11.1	16.9
Frequency (MHz):	18.85	485.00	331.00

Network Compliance: 10BASE-T, 100BASE-T, 1000BASE-T